


NIBE


## AMS10-6 + BA-SVM10-200/6 E



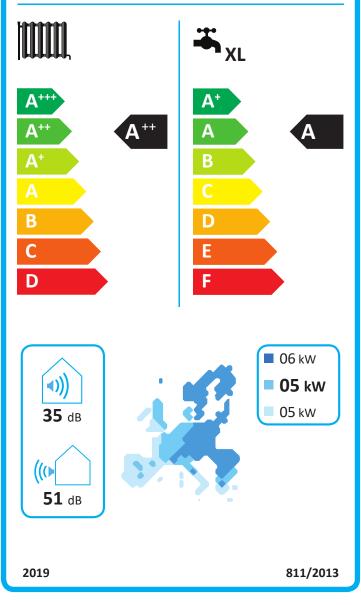

NIBE

## AMS10-6 + BA-SVM10-200/6 E

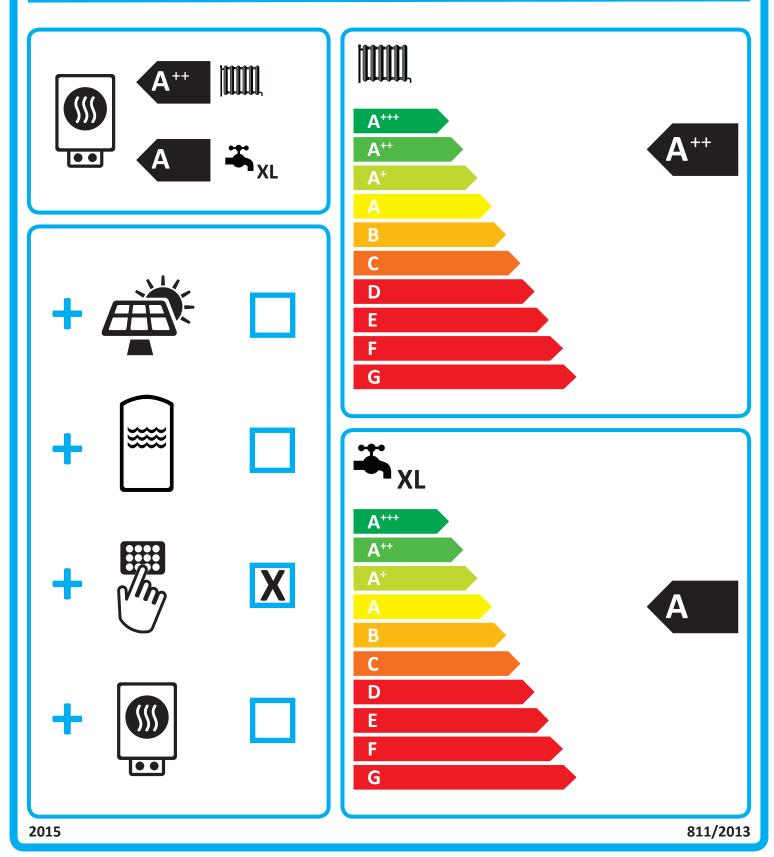

NI			
35	55	°C	
XL			
Δ+++	Δ++		
Аттт	Атт		
Δ			
· · · · · · · · · · · · · · · · · · ·			
5	5	kW	
2080	2249	kWh	
2009	3240	KVVII	
1890		kWh	
		NVVII	
400	404	%	
188	131	%	
01		%	
		, •	
35		dB	
4		kW	
4	5	kW	
2604	4610	kWh	
2094	4010	KVVII	
2397		kWh	
		RVVII	
872	1398	kWh	
012	1000		
1537		kWh	
143	116	%	
70		%	
252	179	%	
10	%		
5	dB		
	AMS10-6 + 35 X A+++ 5 2089 188 188 9 3 4 4 2694 23 872 15 143 7 252	XL   A+++ A++   A   5 5   2089 3248   1890 131   188 131   91 35   4 6   4 5   2694 4610   2397 1398   872 1398   143 116   70 70	

## Data for package fiche

Controller class	V		
Controller contribution to efficiency	4	%	
Seasonal space heating energy efficiency of package, average climate:	192	135	%
Seasonal space heating energy efficiency class for package, average climate:	A+++	A++	%
Seasonal space heating energy efficiency of package, cold climate:	147	120	%
Seasonal space heating energy efficiency of package, warm climate:	256	183	%

Model(s):		AMS1	0-6 + BA-	-SVM10-200/6 E			
Type of heat source/sink:				o-water			
Low-temperature heat pump:			No 🔨 📕				
Equipped with supplementary heater:		,		Yes		ZH)	
Heat pump combination heater:	Imp combination heater:			Yes <b>NIBE</b>			
Climate condition:			Av	erage			
Temperature application:			dium tem	perature (55 °C)			
Applied standards: EN14825, EN16147, EN	l 14511 and	EN 12102					
Rated heat output	Prated	5,3	kW	Seasonal space heating energy efficiency	$\eta_{s}$	131	%
Declared capacity for part load at outdoor temp	erature Tj			Declared coefficient of performance for part	load at outdoo	r temperati	ure Tj
Tj = -7 °C	Pdh	4,7	kW	Tj = -7 °C	COPd	1,88	-
Tj = +2 °C	Pdh	2,8	kW	Tj = +2 °C	COPd	3,26	-
Tj = +7 °C	Pdh	1,8	kW	Tj = +7 °C	COPd	4,72	-
Tj = +12 °C	Pdh	2,7	kW	Tj = +12 °C	COPd	6,47	-
Tj = biv	Pdh	4,7	kW	Tj = biv	COPd	1,88	-
Tj = TOL	Pdh	4,1	kW	Tj = TOL	COPd	1,77	-
Tj = -15 °C (if TOL < -20 °C)	Pdh		kW	Tj = -15 °C (if TOL < -20 °C)	COPd		-
Bivalent temperature	T <sub>biv</sub>	-7	°C	Operation limit temperature	TOL	-10	°C
Cycling interval capacity for heating	Pcych		kW	Cycling interval efficiency	COPcyc		-
Degradation co-efficient	Cdh	0.99	-	Heating water operating limit	WTOL	58	°C
Power consumption in modes other than active	mada	- /		Supplementary heater	_		
Off mode		0,007	kW		Deun	1,2	kW
	P <sub>OFF</sub>	,		Rated heat output	Psup	1,2	ĸvv
Thermostat-off mode	P <sub>TO</sub>	0,012	kW		1		
Standby mode	P <sub>SB</sub>	0,012	kW	Type of energy input	Electric		
Crankcase heater mode	P <sub>CK</sub>	0	kW				
Other items							
Capacity control		variable		Rated air flow rate, outdoors		2526	m³/h
Sound power level, indoors/outdoors	L <sub>WA</sub>	35/51	dB	Rated water flow rate, indoor heat exchanger			m³/h
				Rated brine or water flow rate,			
Annual energy consumption	Q <sub>HE</sub>	3248	kWh	outdoor heat exchanger			m³/h
For heat pump combination heater:							
Declared load profile		XL	[	Water heating energy efficiency	$\eta_{wh}$	91	%
Daily electricity consumption	Q <sub>elec</sub>	8,59	kWh	Daily fuel consumption	Q <sub>fuel</sub>		kWh
Annual electricity consumption	AEC	1890	kWh	Annual fuel consumption	AFC		GJ
Approved by:		1000					
Contact details	@ NUR5 -		-	x 14 - Hannabadsvägen 5 - 28521 Markar			